


LAYOUT

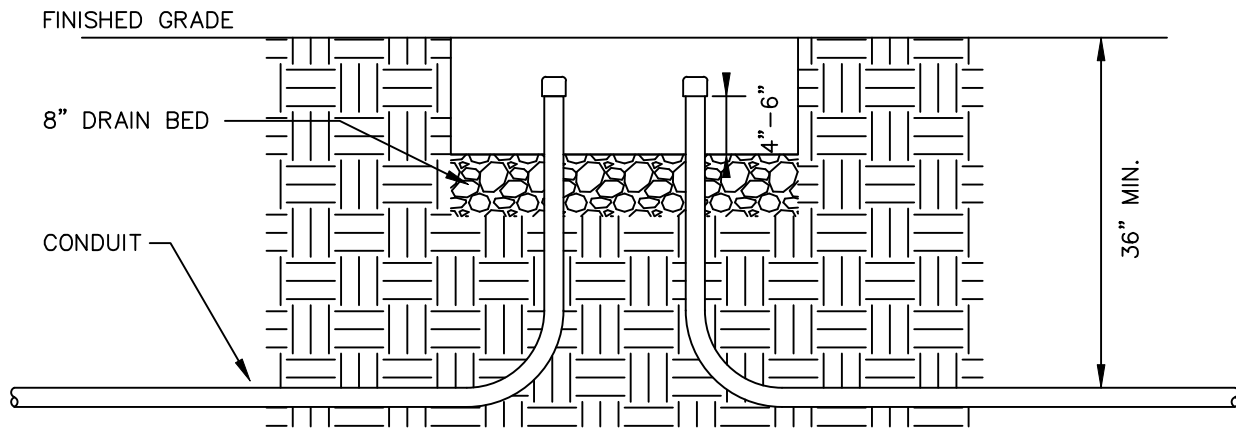

HANDHOLE

NOTE:

1. HANDHOLES SHALL BE:
 - UL LISTED BOXES, NOT TO EXCEED 30"X48"
 - DESIGNED FOR A MINIMUM ANSI/SCTE 77 LOAD RATING TIER 5
 - PRE-CAST POLYMER CONCRETE TYPE BY QUAZITE OR EQUAL
 - INSTALLED AT GRADE ON A 8" THICK AGGREGATE DRAIN BED OF GRAVEL OR CRUSHED ROCK
2. CONDUIT SHALL BE:
 - 4" MULTI-CELL DUCTED CONDUIT WITH 4 INNER DUCTS, SCHEDULE 40, GRAY PVC, WITH METALLIC JET STRING OR MULE STRING
 - TRACEABLE
 - TEMPORARILY CAPPED AT ENDS AFTER INSTALLATION
 - INSTALLED IN CONFORMANCE WITH THE NATIONAL ELECTRIC SAFETY CODE (LATEST EDITION) AND NATIONAL ELECTRIC CODE (LATEST EDITION), AS APPLICABLE; INSTALLED TO MEET OR EXCEED ELECTRONICS INDUSTRY ASSOCIATION AND TELECOMMUNICATIONS INDUSTRY ASSOCIATION STANDARDS



STANDARD CONSTRUCTION DETAIL
FIBER OPTIC CABLE & HANDHOLES

REV. 12/18

FILE NAME:

M11.DWG

DETAIL REF:

M-11