


U.S.F. No. 667 RING, CR & BJ,  
 WITH 4 TO 6 1" HOLES IN COVER;  
 COVER SHALL BE LABELED WATER,  
 OR RECLAIMED WATER, AS  
 APPROPRIATE



**NOTES:**

- 1. ALL AIR RELEASE MANHOLES MUST HAVE MANHOLE COVERS THAT WILL VENT GASSES.

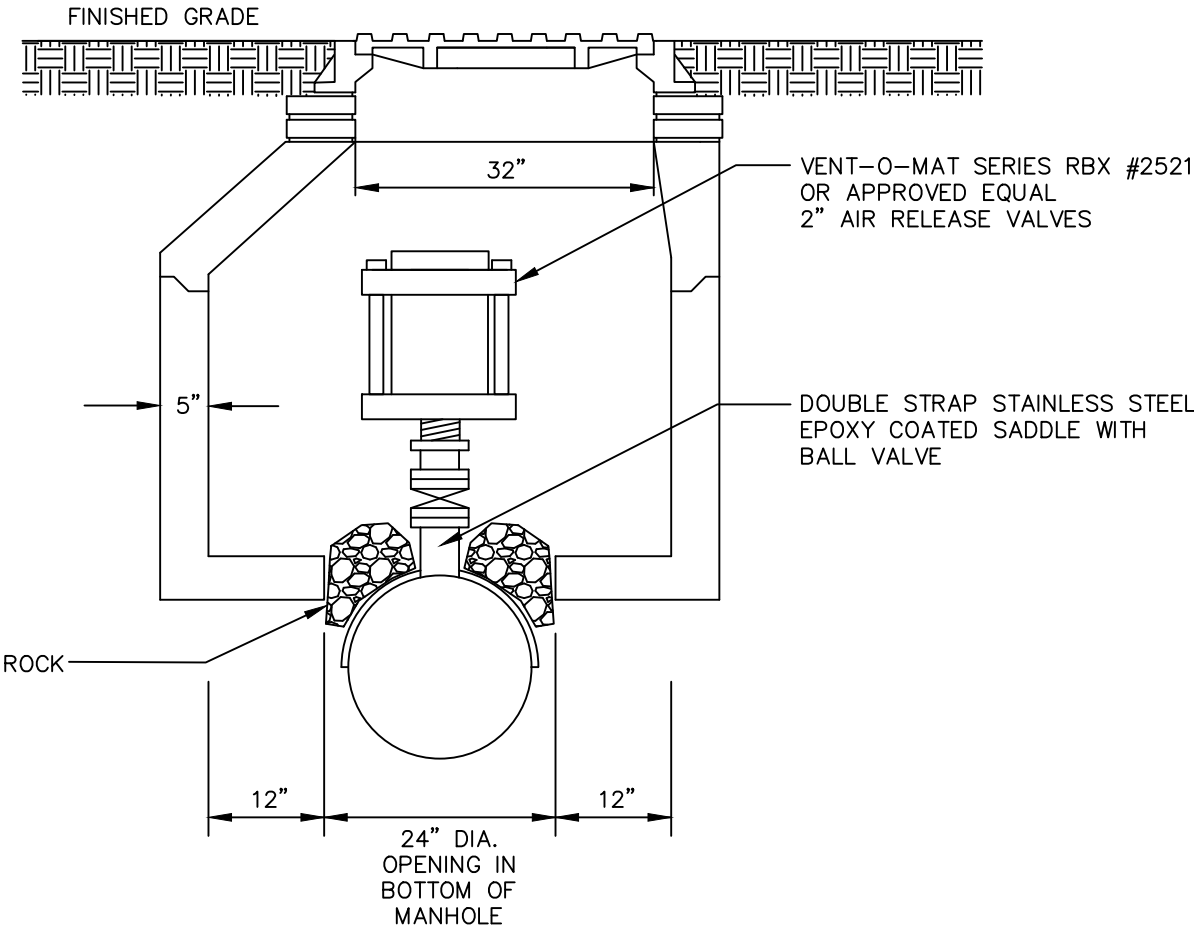

STANDARD CONSTRUCTION DETAIL  
 AIR RELEASE VALVE PIT

REV. 12/18

FILE NAME:

W19.DWG

DETAIL REF:

**W-19**