


SECTION A-A

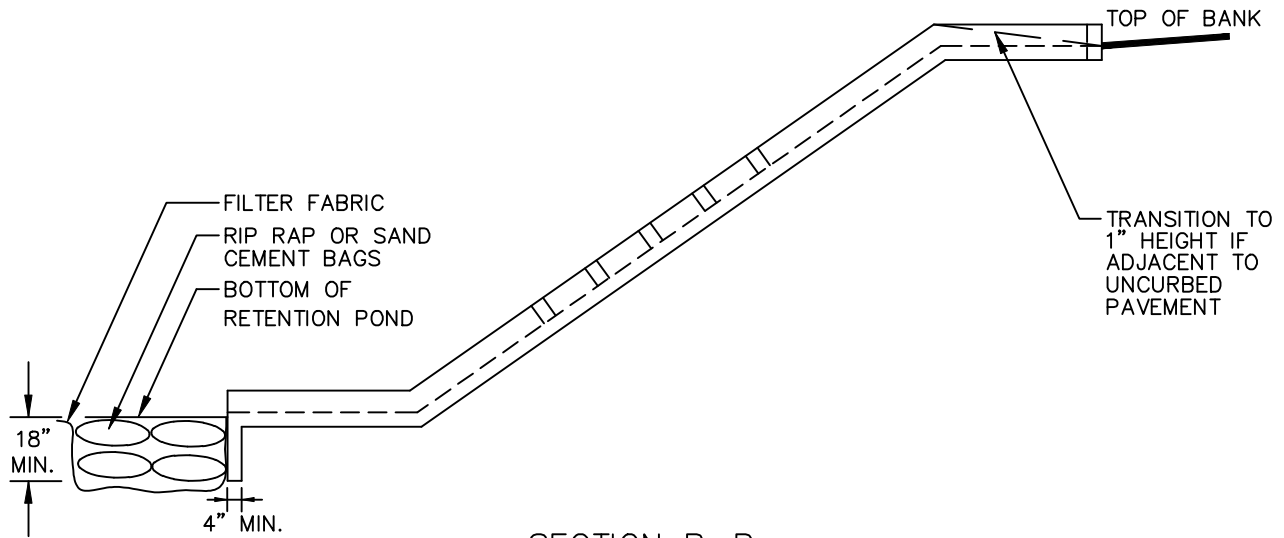

SECTION B-B

NOTES:

1. SPILLWAY TO BE CONCRETE, 2,500 PSI AT 28 DAY, 4" THICK FIBERCRETE.
2. PLACE SOD AT LEAST 5' AROUND ALL STRUCTURE EDGES ABOVE STANDING WATER.



STANDARD CONSTRUCTION DETAIL
CONCRETE SPILLWAY

FILE NAME:

ST7.DWG

DETAIL REF:

ST-7

REV. 12/18